


Vsak prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
This document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.

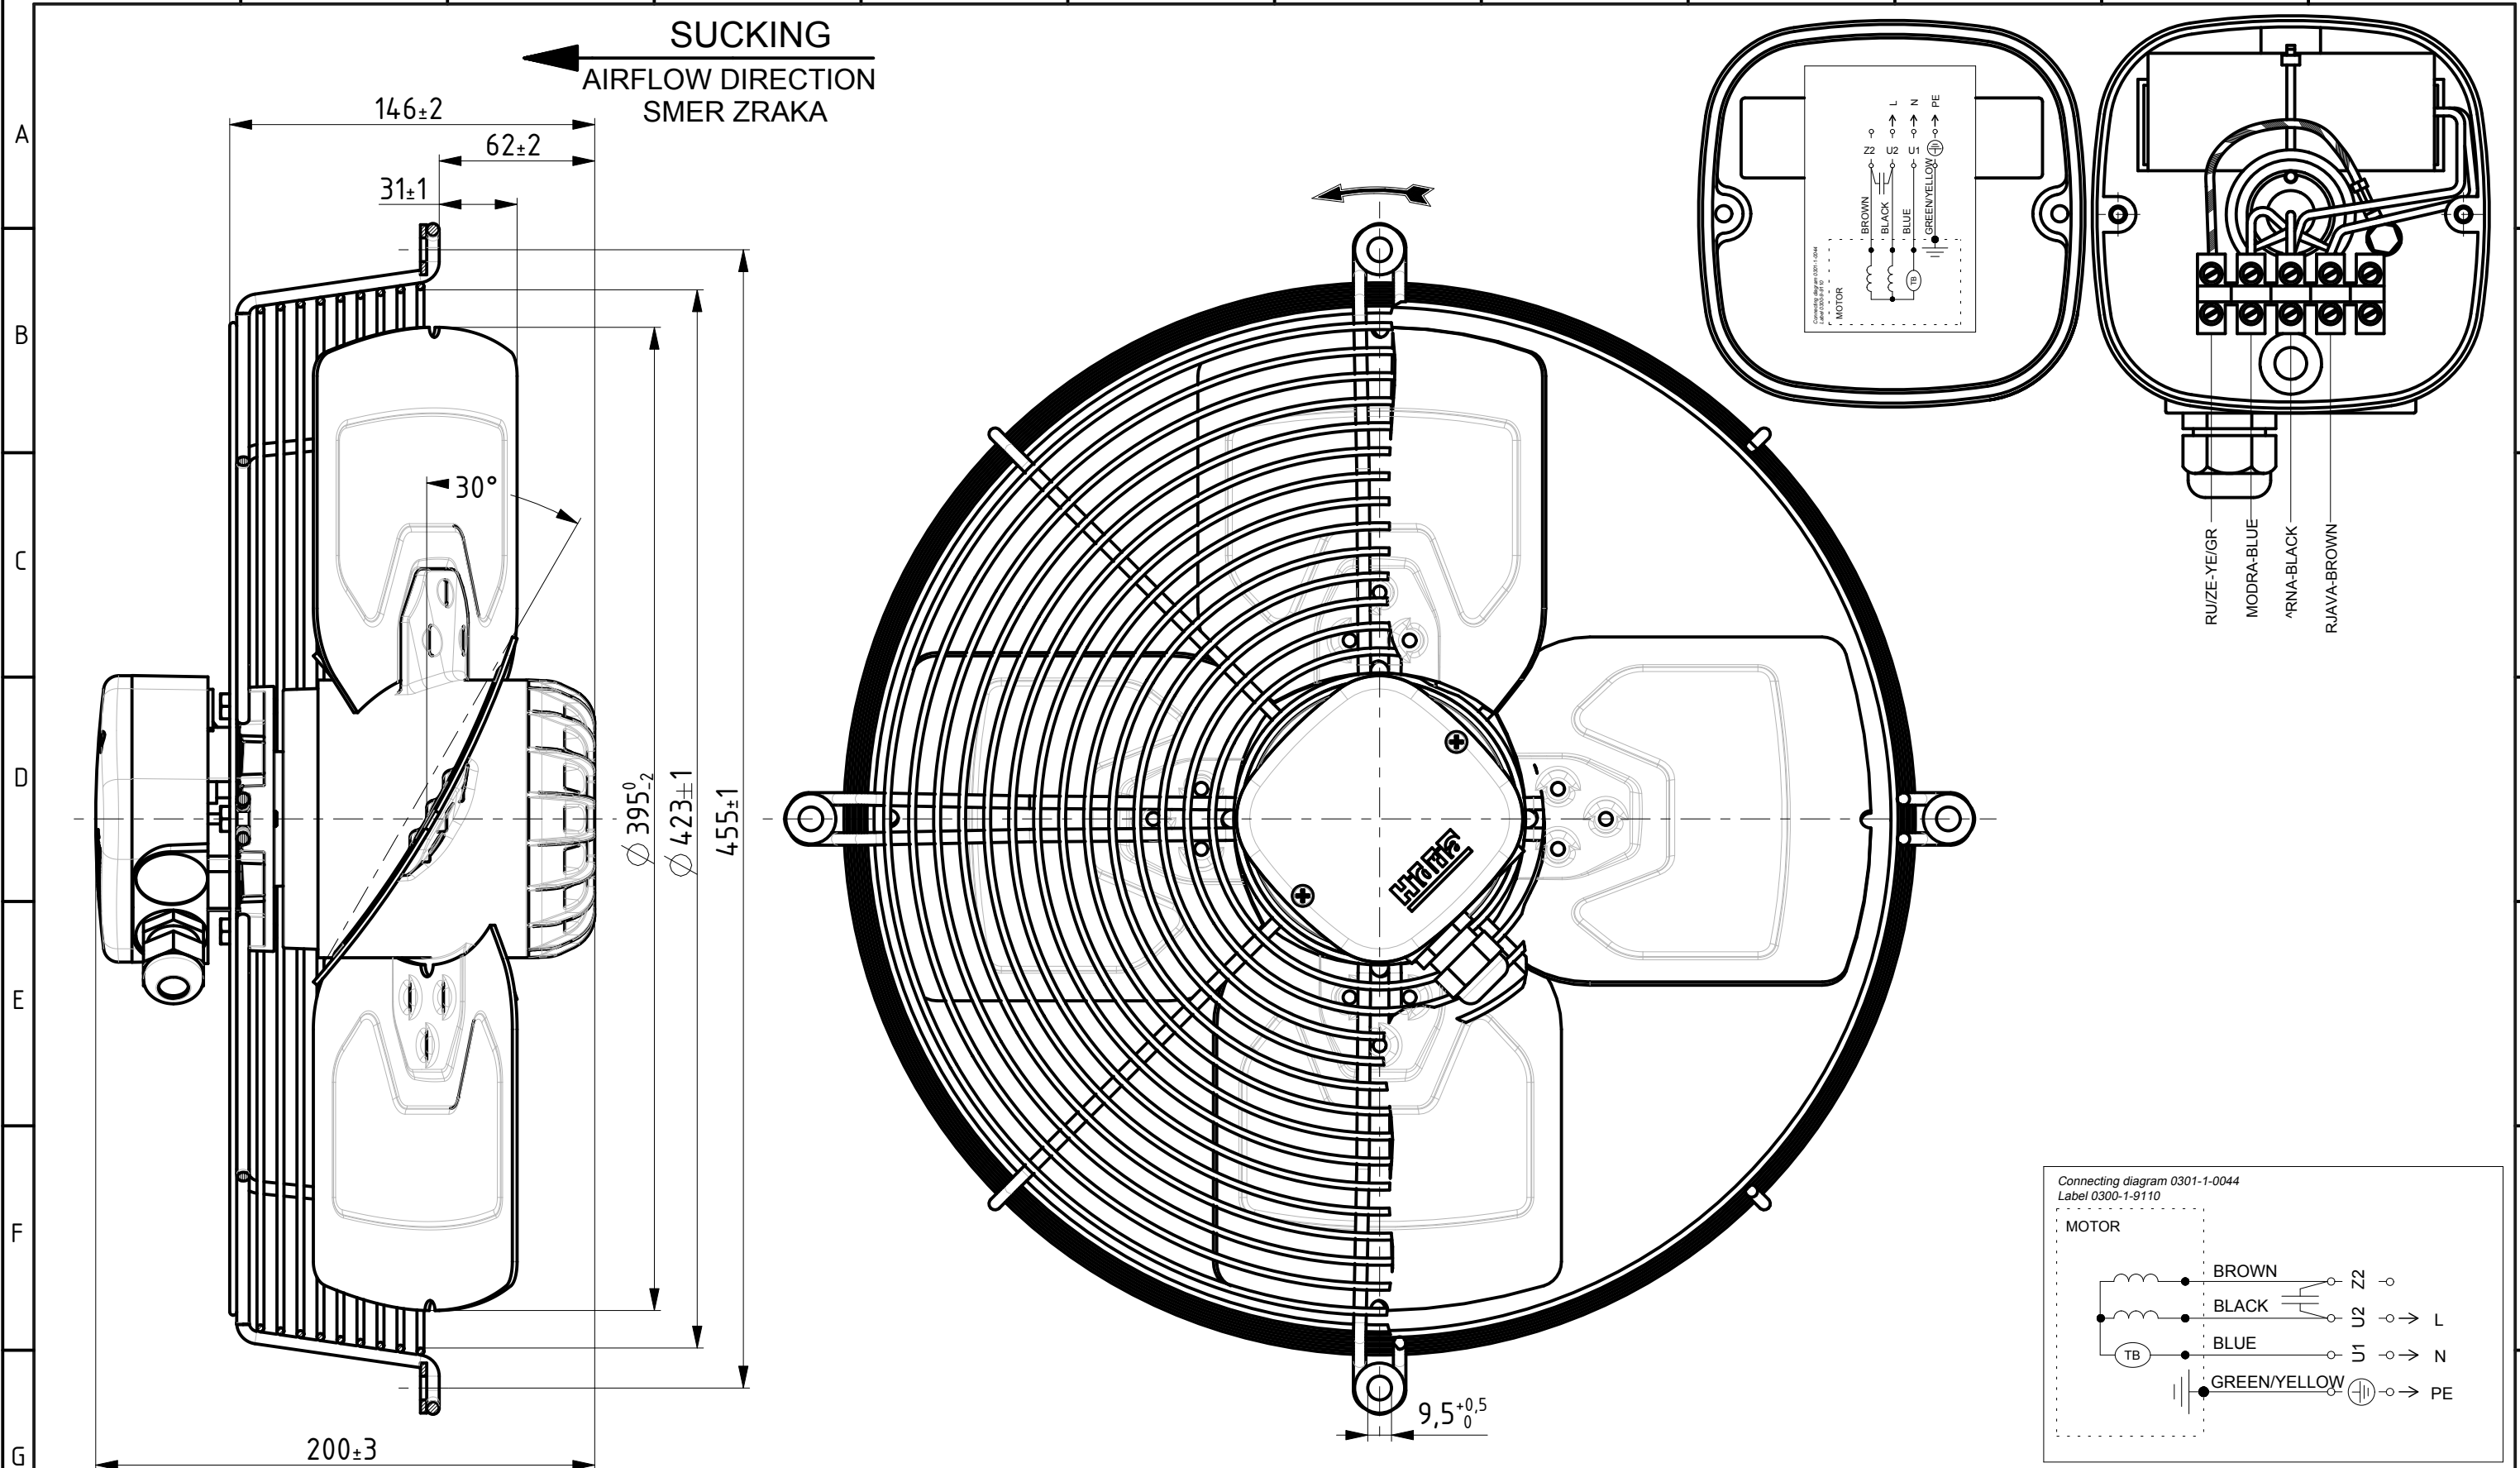

Opomba: - navodilo za kontrolo ventilatorja 0301-1-4455 - checking instruction 0301-1-4455				ErP: Effes=32,1% (A,static) N=42,5			
ISO 2768-m				VENTILATOR R11R-4030A-4M-5137			
DATE				VERZIJA: AB			
DATE				LIST: 1			
DATE				OF: 1			