

## Product information

Brass air separator. With gas separator and dirt-protected mechanism.

Dimension range (DN)	20 - 50
PN	10
Temperature (°C)	0 - 180
Main material	Brass



## Area of use

Exvoid A for automatic air separation of heating and cooling systems where the fluid is water or glycol. Can be mounted in 50% concentration systems with a mix of water/glycol, if control and oversight is increased. The valve should not be used in systems with a mix of water/salts. Separates effective microbubbles.

## Tender text

### **PSF.141 Traps for air**

AT 8032-... automatic air separator , Exvoid A, brass, PN10, with a large air chamber and dirt protection mechanism.

## Quality assurance

PED 2014/68/EU

Fulfills AFS 1994:4 §8 standards and should not be CE-marked. All extractors are tightness tested.

**Product marking:** Marked with dimension, max. operation pressure, max. operation pressure and the manufacturers name.

## Energy and environment declaration

**Product Bvb:** Avoided

**Product BVB ID:** 110736


**Subject to notification under REACH**

**Reach date:** 9/23/2024 11:58:00 AM

Item number	SCIP number
8032-20	b96bd078-6c57-440b-b5e4-ded384464724
8032-22	b96bd078-6c57-440b-b5e4-ded384464724
8032-25	b96bd078-6c57-440b-b5e4-ded384464724
8032-32	b96bd078-6c57-440b-b5e4-ded384464724
8032-40	b96bd078-6c57-440b-b5e4-ded384464724
8032-50	b96bd078-6c57-440b-b5e4-ded384464724
8032H20	8894d6b8-7bae-4950-b745-14a80be0e50f
8032H22	8894d6b8-7bae-4950-b745-14a80be0e50f
8032H25	8894d6b8-7bae-4950-b745-14a80be0e50f
8032H32	8894d6b8-7bae-4950-b745-14a80be0e50f
8032H40	8894d6b8-7bae-4950-b745-14a80be0e50f

List of details

Pos	Component	Material
1	Unique valve mechanism in leak-proof design.	Brass
2	Large volume air chamber for maximum reliability.	Other
3	Body	Brass
4	A special polytetrafluoroethylene float prevents dirt from reaching the valve.	PTFE (polytetrafluoroethylene)
5	Gas separator, wire mesh optimally separates the free gas bubbles.	Other

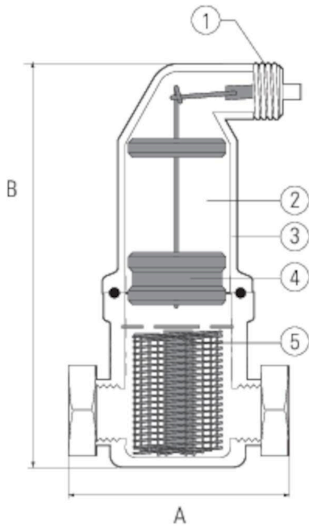

Measurements and weight

Dimension range (DN): 20 - 50

DN	A	B	Net weight (kg)
20	85	165	1.1
22	106	165	1.1
25	88	180	1.2
32	88	202	1.3
40	88	236	1.5
50	132	277	3.9

## Function and design

The velocity decreases as the fluid flows into the separation body and the gas-free bubbles are being optimally separated when they pass through the separator. The separated bubbles flows up into the float body. The liquid level goes down and the float sinks.

The float, that is connected with the separation mechanism by a chain, has reached a certain low level, the mechanism is affected and air can flow into the free. When the float rises again, the mechanism closes. The large volume of the air chamber and special design makes the liquid level never reach the drainage mechanism, even if the air in the chamber is compressed to 10 bar.

An automatic air vent diverts only free gas bubbles. Gas that is dissolved in the fluid, due to high pressure and/or low temperature, can not be diverted. Can suck air in case of negative pressure. It will be a problem when system pressure is incorrect. But has an advantage in decomposing the system.

## Technical data

**Main material:** Brass

**Included materials:** Brass


**Temperature (°C):** 0 - 180

**PN:** 10

**Connection:** Internal thread ISO 228-1 (G, BSPP), External thread ISO 228-1 (G, BSPP), Olive & Nut

**ETIM classification:** EC010117 - De-aerator (automatic)

**Comment to colour:** Brass untreated

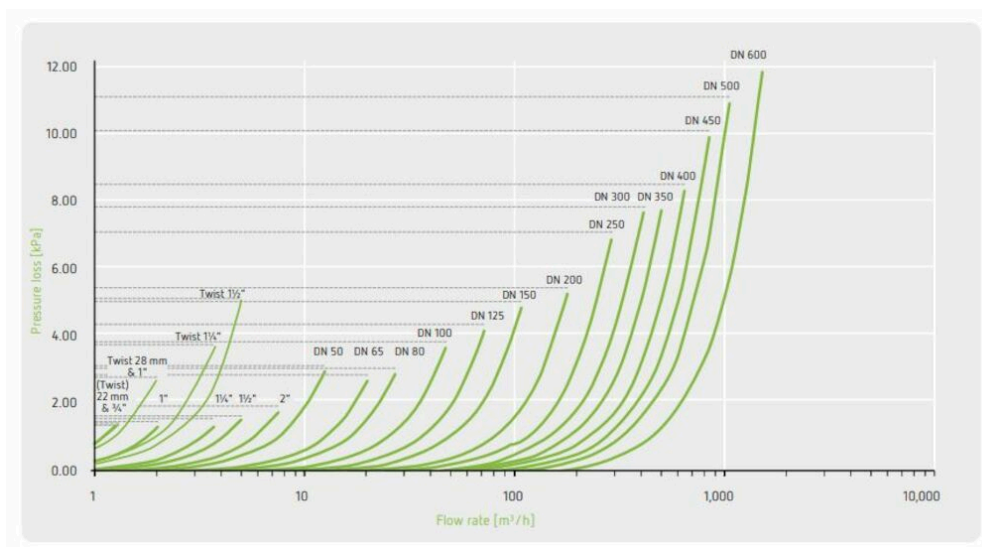

DN	Max system flow (m³/h)	Execution	Connection 1	Connection 1 - spec.	Connection 2	Connection 2 - spec.
20	1.25		Internal thread ISO 228-1 (G, BSPP)	3/4	External thread ISO 228-1 (G, BSPP)	1/2
22	1.2		Olive & Nut	22mm	External thread ISO 228-1 (G, BSPP)	1/2
25	2		Internal thread ISO 228-1 (G, BSPP)	1	External thread ISO 228-1 (G, BSPP)	1/2
32	3.7		Internal thread ISO 228-1 (G, BSPP)	1 1/4	External thread ISO 228-1 (G, BSPP)	1/2
40	5		Internal thread ISO 228-1 (G, BSPP)	1 1/2	External thread ISO 228-1 (G, BSPP)	1/2
50	7.5		Internal thread ISO 228-1 (G, BSPP)	2	External thread ISO 228-1 (G, BSPP)	1/2

## Installation and maintenance

### **Possible mounting position:** Horizontal

Since the micro bubbles are released at the hottest point in the plant, the component should be placed on the hottest spoint in the system. In a heating system is the warmest point usually on the supply line, as close to the heater as possible. In order to maintain a good absorption effect, the static pressure at the site of installation should not exceed 15-20mvc.

In a cooling system is the warmest point often in the return line before the cooler. To enable the float to move and blow out the air the pressure needs to ba around 0,3-0,5 bar by the installation point.

The separator should be checked regularly and cleaned if necessary.

### Please feel free to contact us

We answer your questions by e-mail and telephone. No question is too small, no challenge is too big. You are always welcome at Armatec.

[info@armatec.se](mailto:info@armatec.se) | +46 31 89 01 00 | [www.armatec.se](http://www.armatec.se)

THE COMPANY'S MANAGEMENT SYSTEM  
IS CERTIFIED BY DNV  
ISO 9001 • ISO 14001