


Vsak prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
This document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.

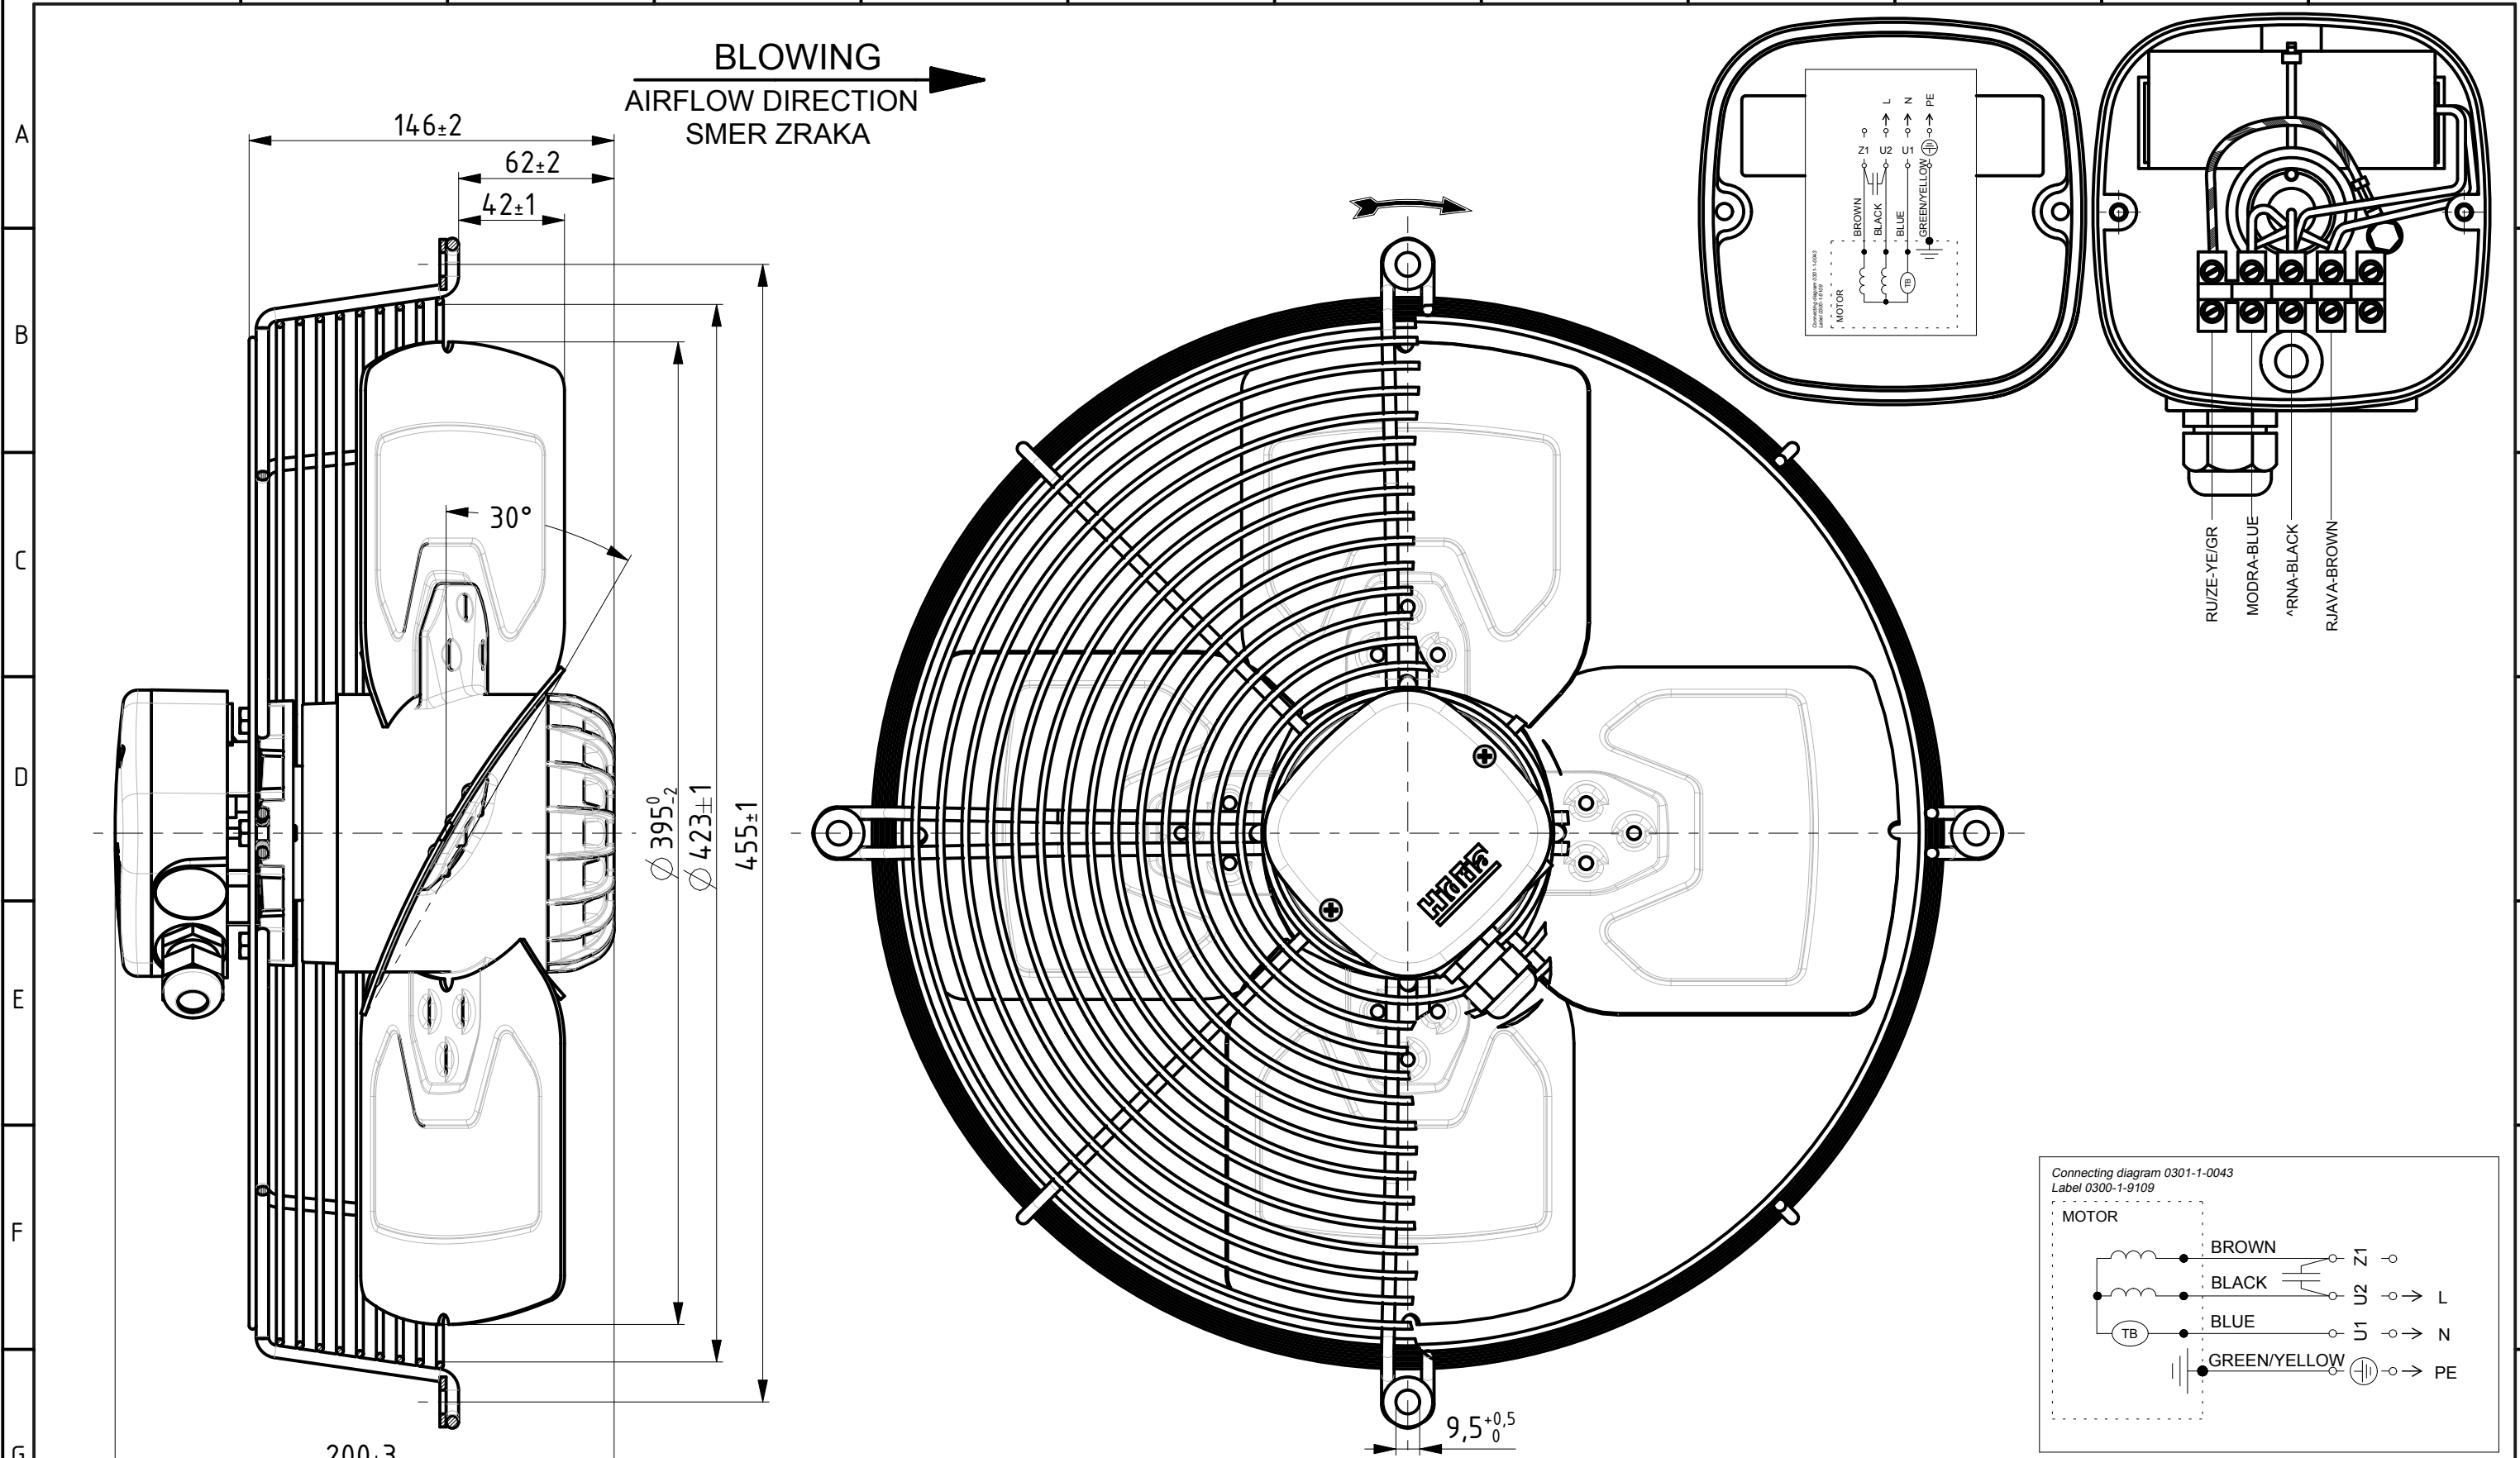

Opomba:
- navodilo za kontrolo ventilatorja 0301-1-4473
- checking instruction 0301-1-4473

**MADE IN SLOVENIA**

DATE

R11R-4030P-4M-51370311-4-0193

1~230V 50/60Hz 200/265W 0,90/1,15A 1345/1500RPM

MAX.AMB.60/45° C IP54 INS.CL.155 C=6,3µF/450V

TH.PROT. ROT. ←

ErP: Effes=32,1% (A,static) N=42,5

				NETOLERIRANE MERE UNTOLERANCED DIM.		ISO 2768-m		MERILO/FORMAT 2:5 / A3			
				POVRŠINSKA OBD. SURFACE TEXTURE				MATERIAL			
Izdano						DATUM	PODPIS	NAZIV: TITLE: VENTILATOR R11R-4030P-4M-5137			
				RISAL	29-Jan-2007	Uroš K.					
			PROJEKTIRAL	29-Jan-2007	Stane P.						
			POTRDL ROBOTNIKA MOTORS								
			POTRDL SPE LIVARSTVO								
			POTRDL SPE LAPELE			KODA: CODE:		VERZIJA: REV:		LIST: SHEET:	
2	239/12	24-Okt-2012	Uroš K.	POTRDL ROBOTNIKA FANS		0311-4-0193 0311-4-0193		AB		1	
1	111/08	20-Mar-2008	Uroš K.	POTRDL						OD: OF:	
ST.	ST.SPR.	DATUM	PODPIS							1	