
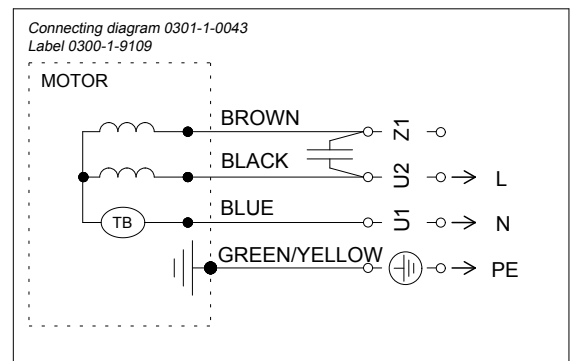
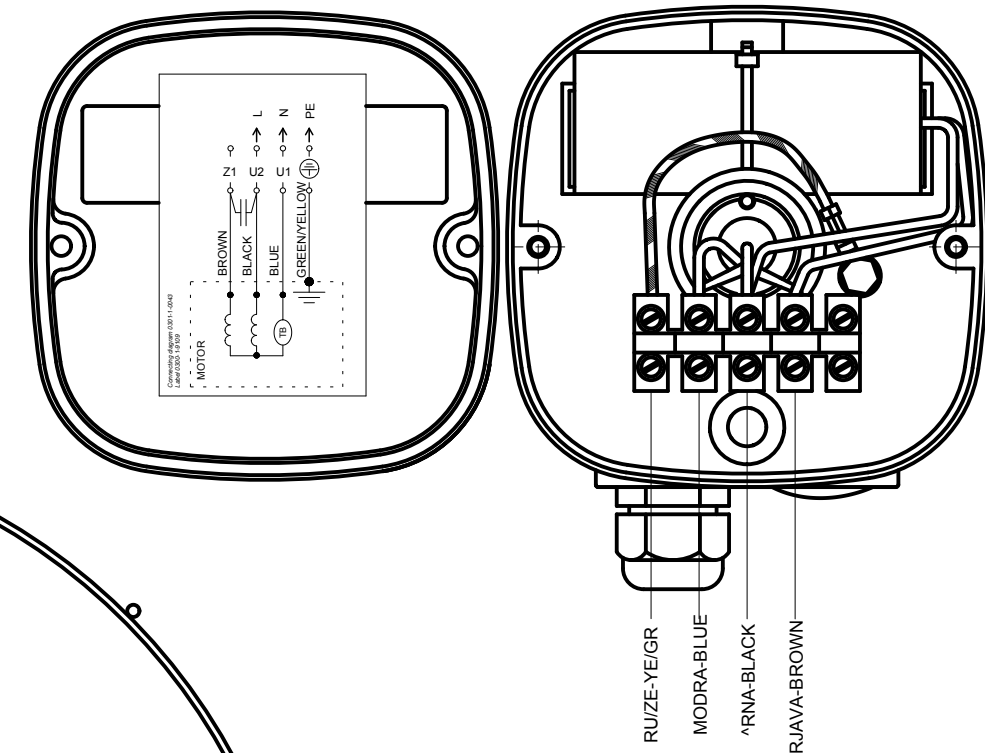
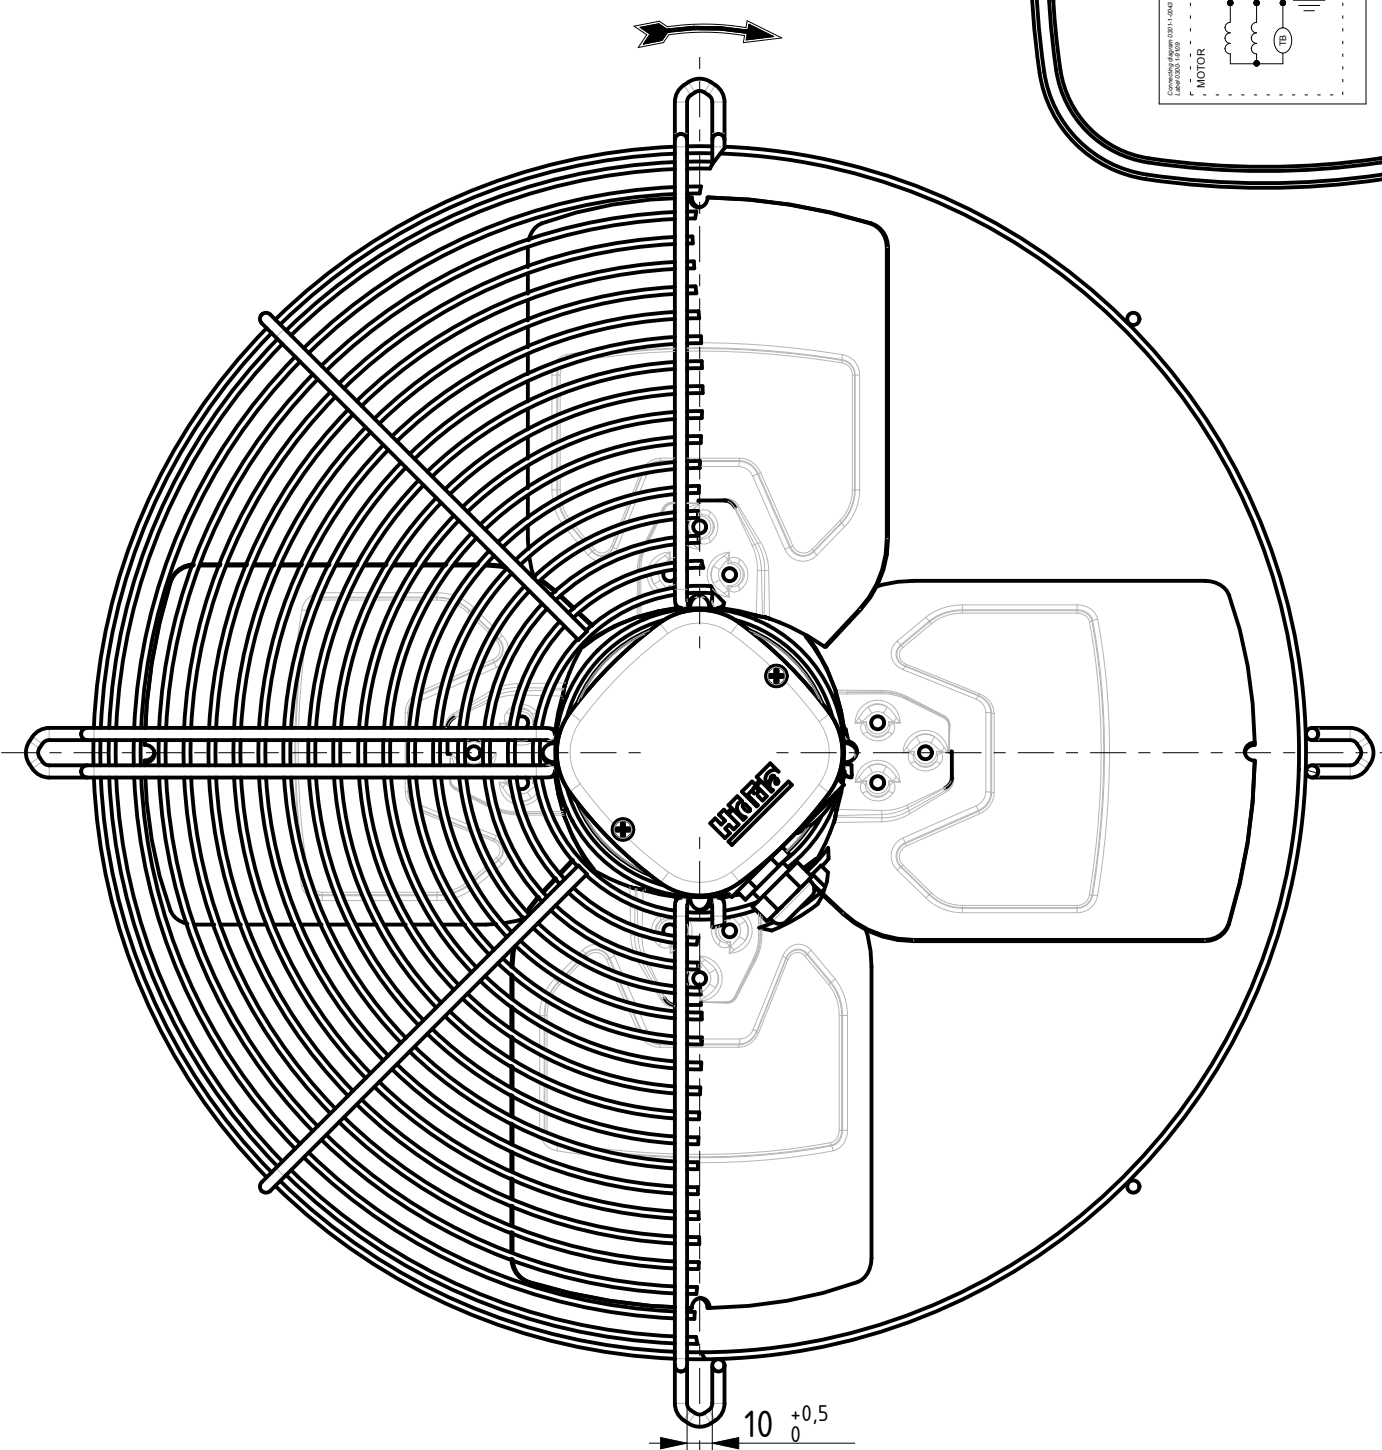


Vsak prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
This document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.

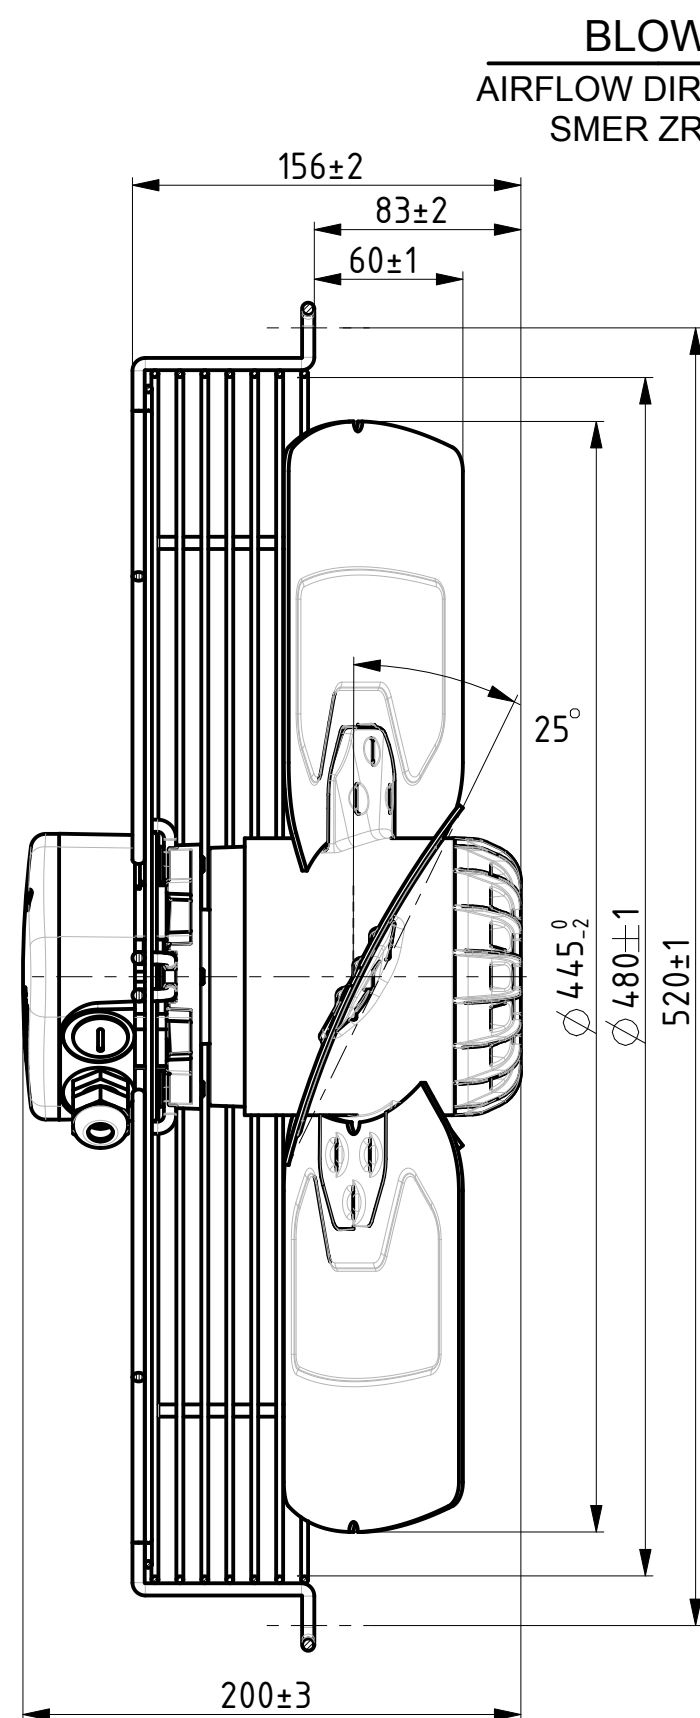

Opomba:
- navodilo za kontrolo ventilatorja 0301-1-4127
- checking instruction 0301-1-4127

**MADE IN SLOVENIA**

DATE


R11R-4525P-4M-51350311-4-0138

1~230-240V 50-60Hz 220W 1,0A 1370RPM

MAX.AMB.50° C IP54 INS.CL.155 C=6,5µF/450V

TH.PROT. ROT. 

ErP: Effes=29,7% (A,static) N=39,3

			NETOLERIRANE MERE UNTOLERANCED DIM.		ISO 2768-m		MERILO/FORMAT 33:100 / A3			
POVRŠINSKA OBD. SURFACE TEXTURE							MATERIAL			
Izdano					DATUM		PODPIS		NAZIV: TITLE:	
			RISAL		29-Sep-2003		Uroš K.		VENTILATOR R11R-4525P-4M-5135	
			PROJEKTIRAL						KODA: CODE:	
5			238/12		23-Okt-2012		Uroš K.		VERZIJA: REV:	
4			111/08		14-Mar-2008		Uroš K.		AB	
3			11/04		23-Jan-2004		Uroš K.		LIST: SHEET: 1	
2			169/03		18-Dec-2003		Uroš K.		OD: OF: 1	
1			163/03		17-Dec-2003		Uroš K.			
ST.			ST.SPR.		DATUM		PODPIS			