
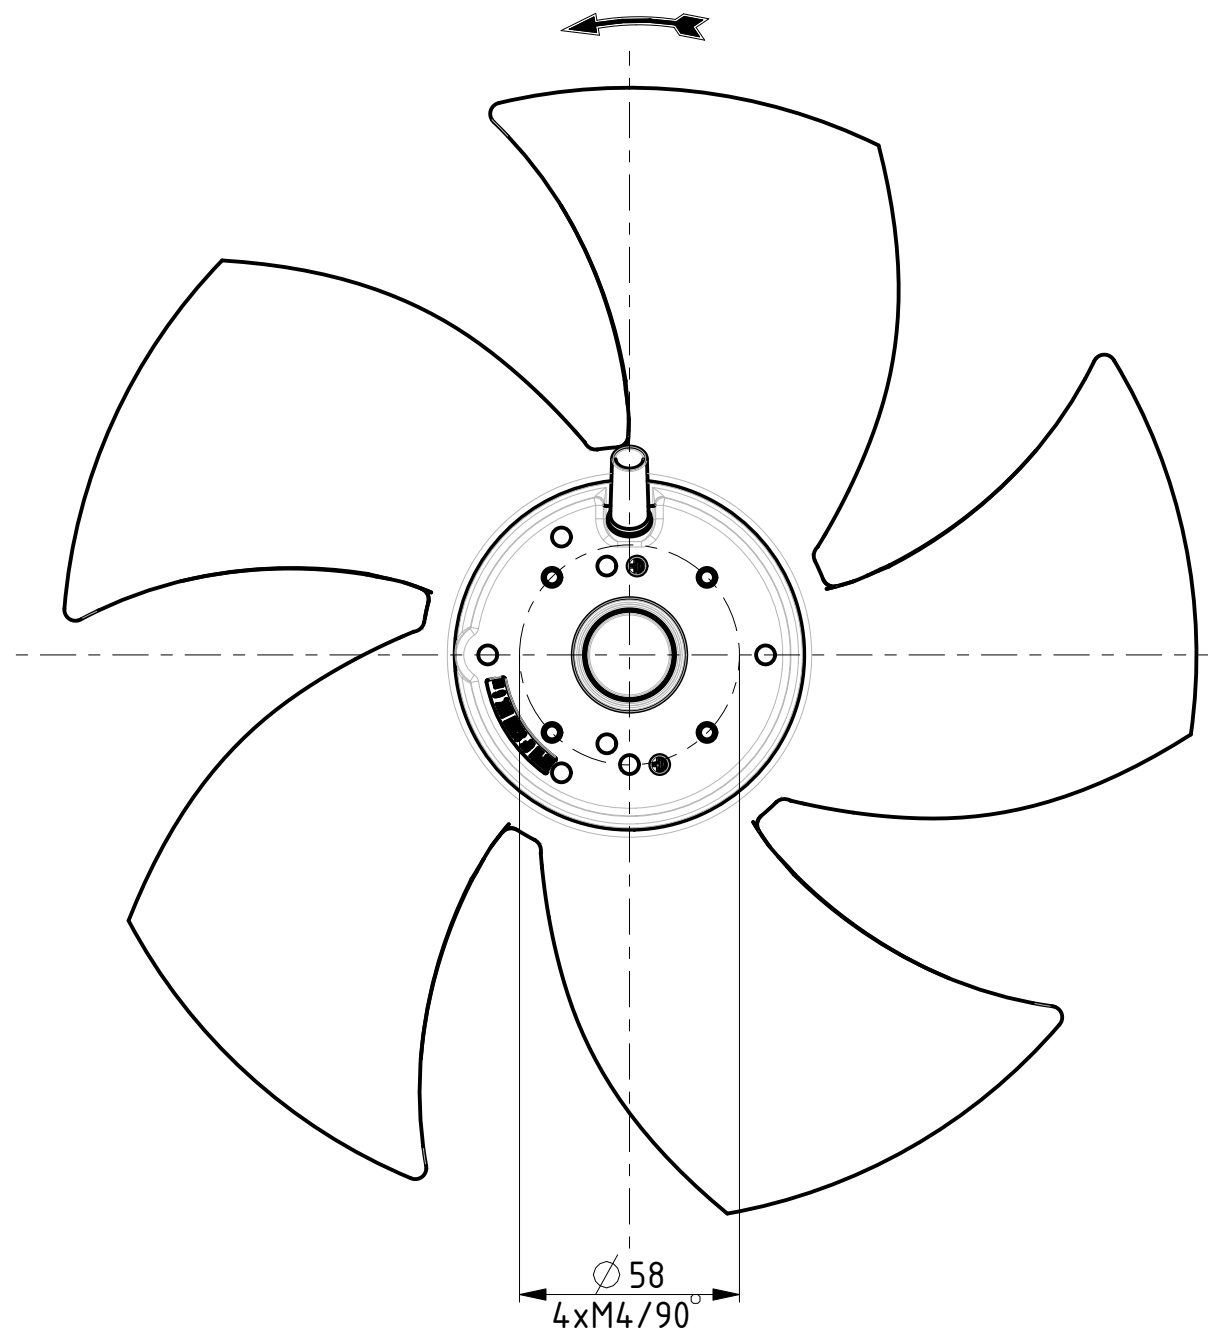



Vsak prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
This document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.

A
B
C
D
E
F
G
H

BLOWING
AIRFLOW DIRECTION
SMER ZRAKA

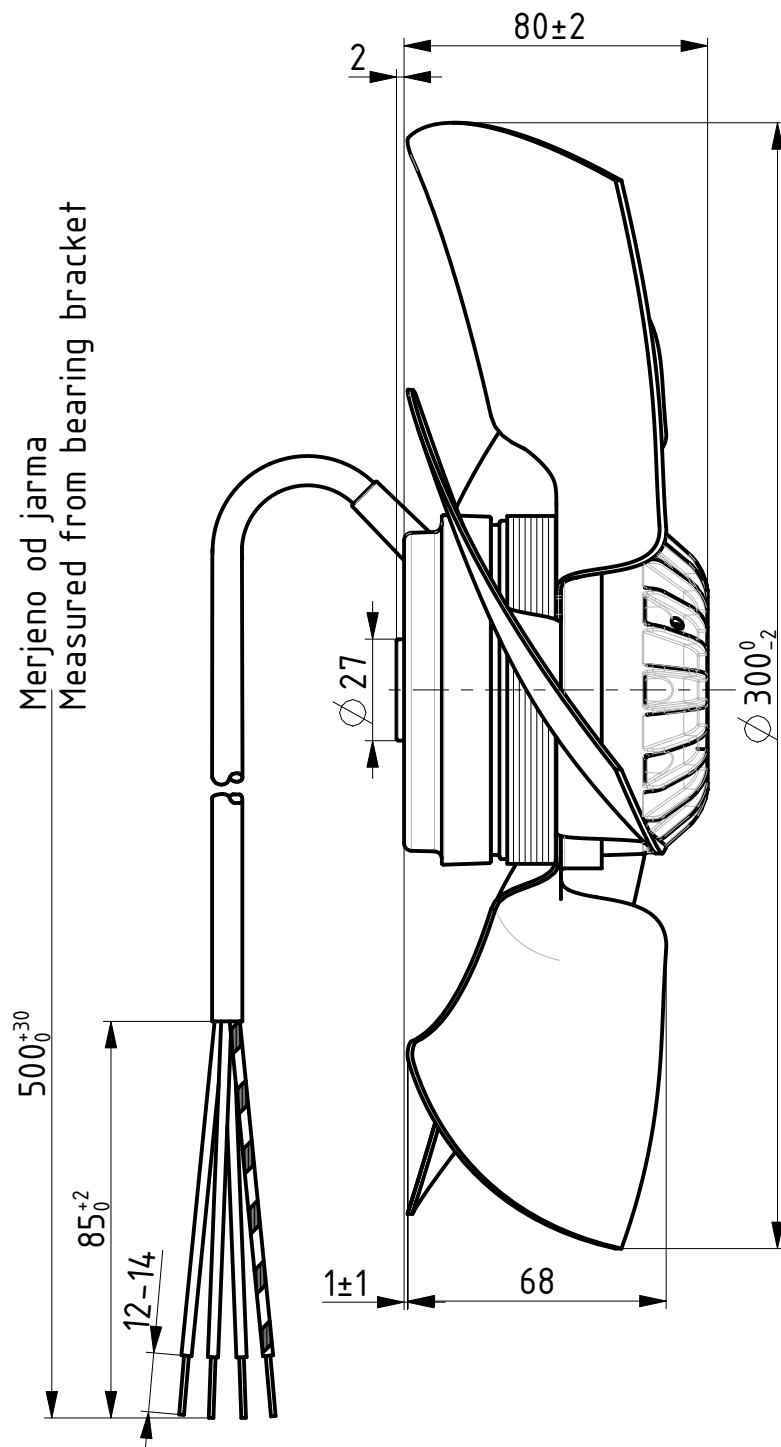

HORMA
for
NORDICOLD
R09E-3030HP-4M-2543
1~230/240V 0.30/0.40A
50/60Hz 65/90W
1400/1500RPM TH.PROT.
C=2µF/450V INS.CL.155(F) IP44
DATE
0309-4-1084
CE

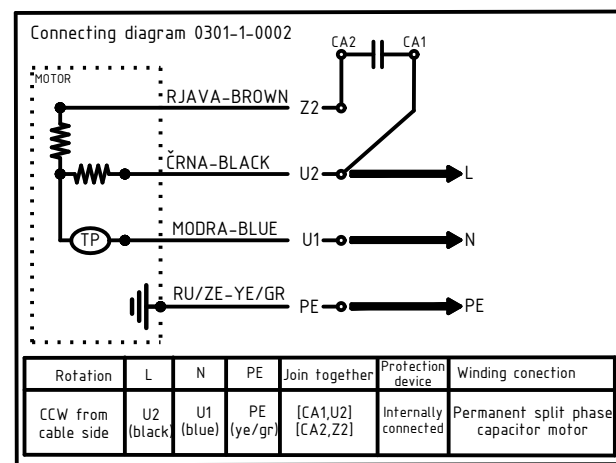

V vsako škatlo priložiti priključno shemo 0301-1-0002.
Navodilo za kontrolo ventilatorja 0301-1-4586
In each box connection diagram 0301-1-00002 has to be added
Checking instructions 0301-1-4586

HORMA				NETOLERIRANE MERE UNTOLERANCED DIM.		ISO 2768-m		MERILO/FORMAT 1:2 / A3					
				POVRŠINSKA OBD. SURFACE TEXTURE				MATERIAL					
Izdano					DATUM	PODPIS	NAZIV: TITLE: VENTILATOR R09E-3030HP-4M-2543						
				RISAL	04-Jul-2011	Uroš K.							
			PROJEKTIRAL	04-Jul-2011	Jure L.								
			POTRDL ROTOMATIKA MOTORS										
			POTRDL SPE LIVARSTVO										
			POTRDL SPE LAEME										
			POTRDL ROTOMATIKA FANS			KODA: CODE:		0309-4-1084 0309-4-1084		VERZIJA: REV: AA		LIST: SHEET: 1	
1	169/11	04-Jul-2011	Uroš K.	POTRDL									
ST.	ST.SPR.	DATUM	PODPIS									OD: OF:	1

1 2 3 4 5 6 7 8 9 10 11 12