


Vsak prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
This document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.

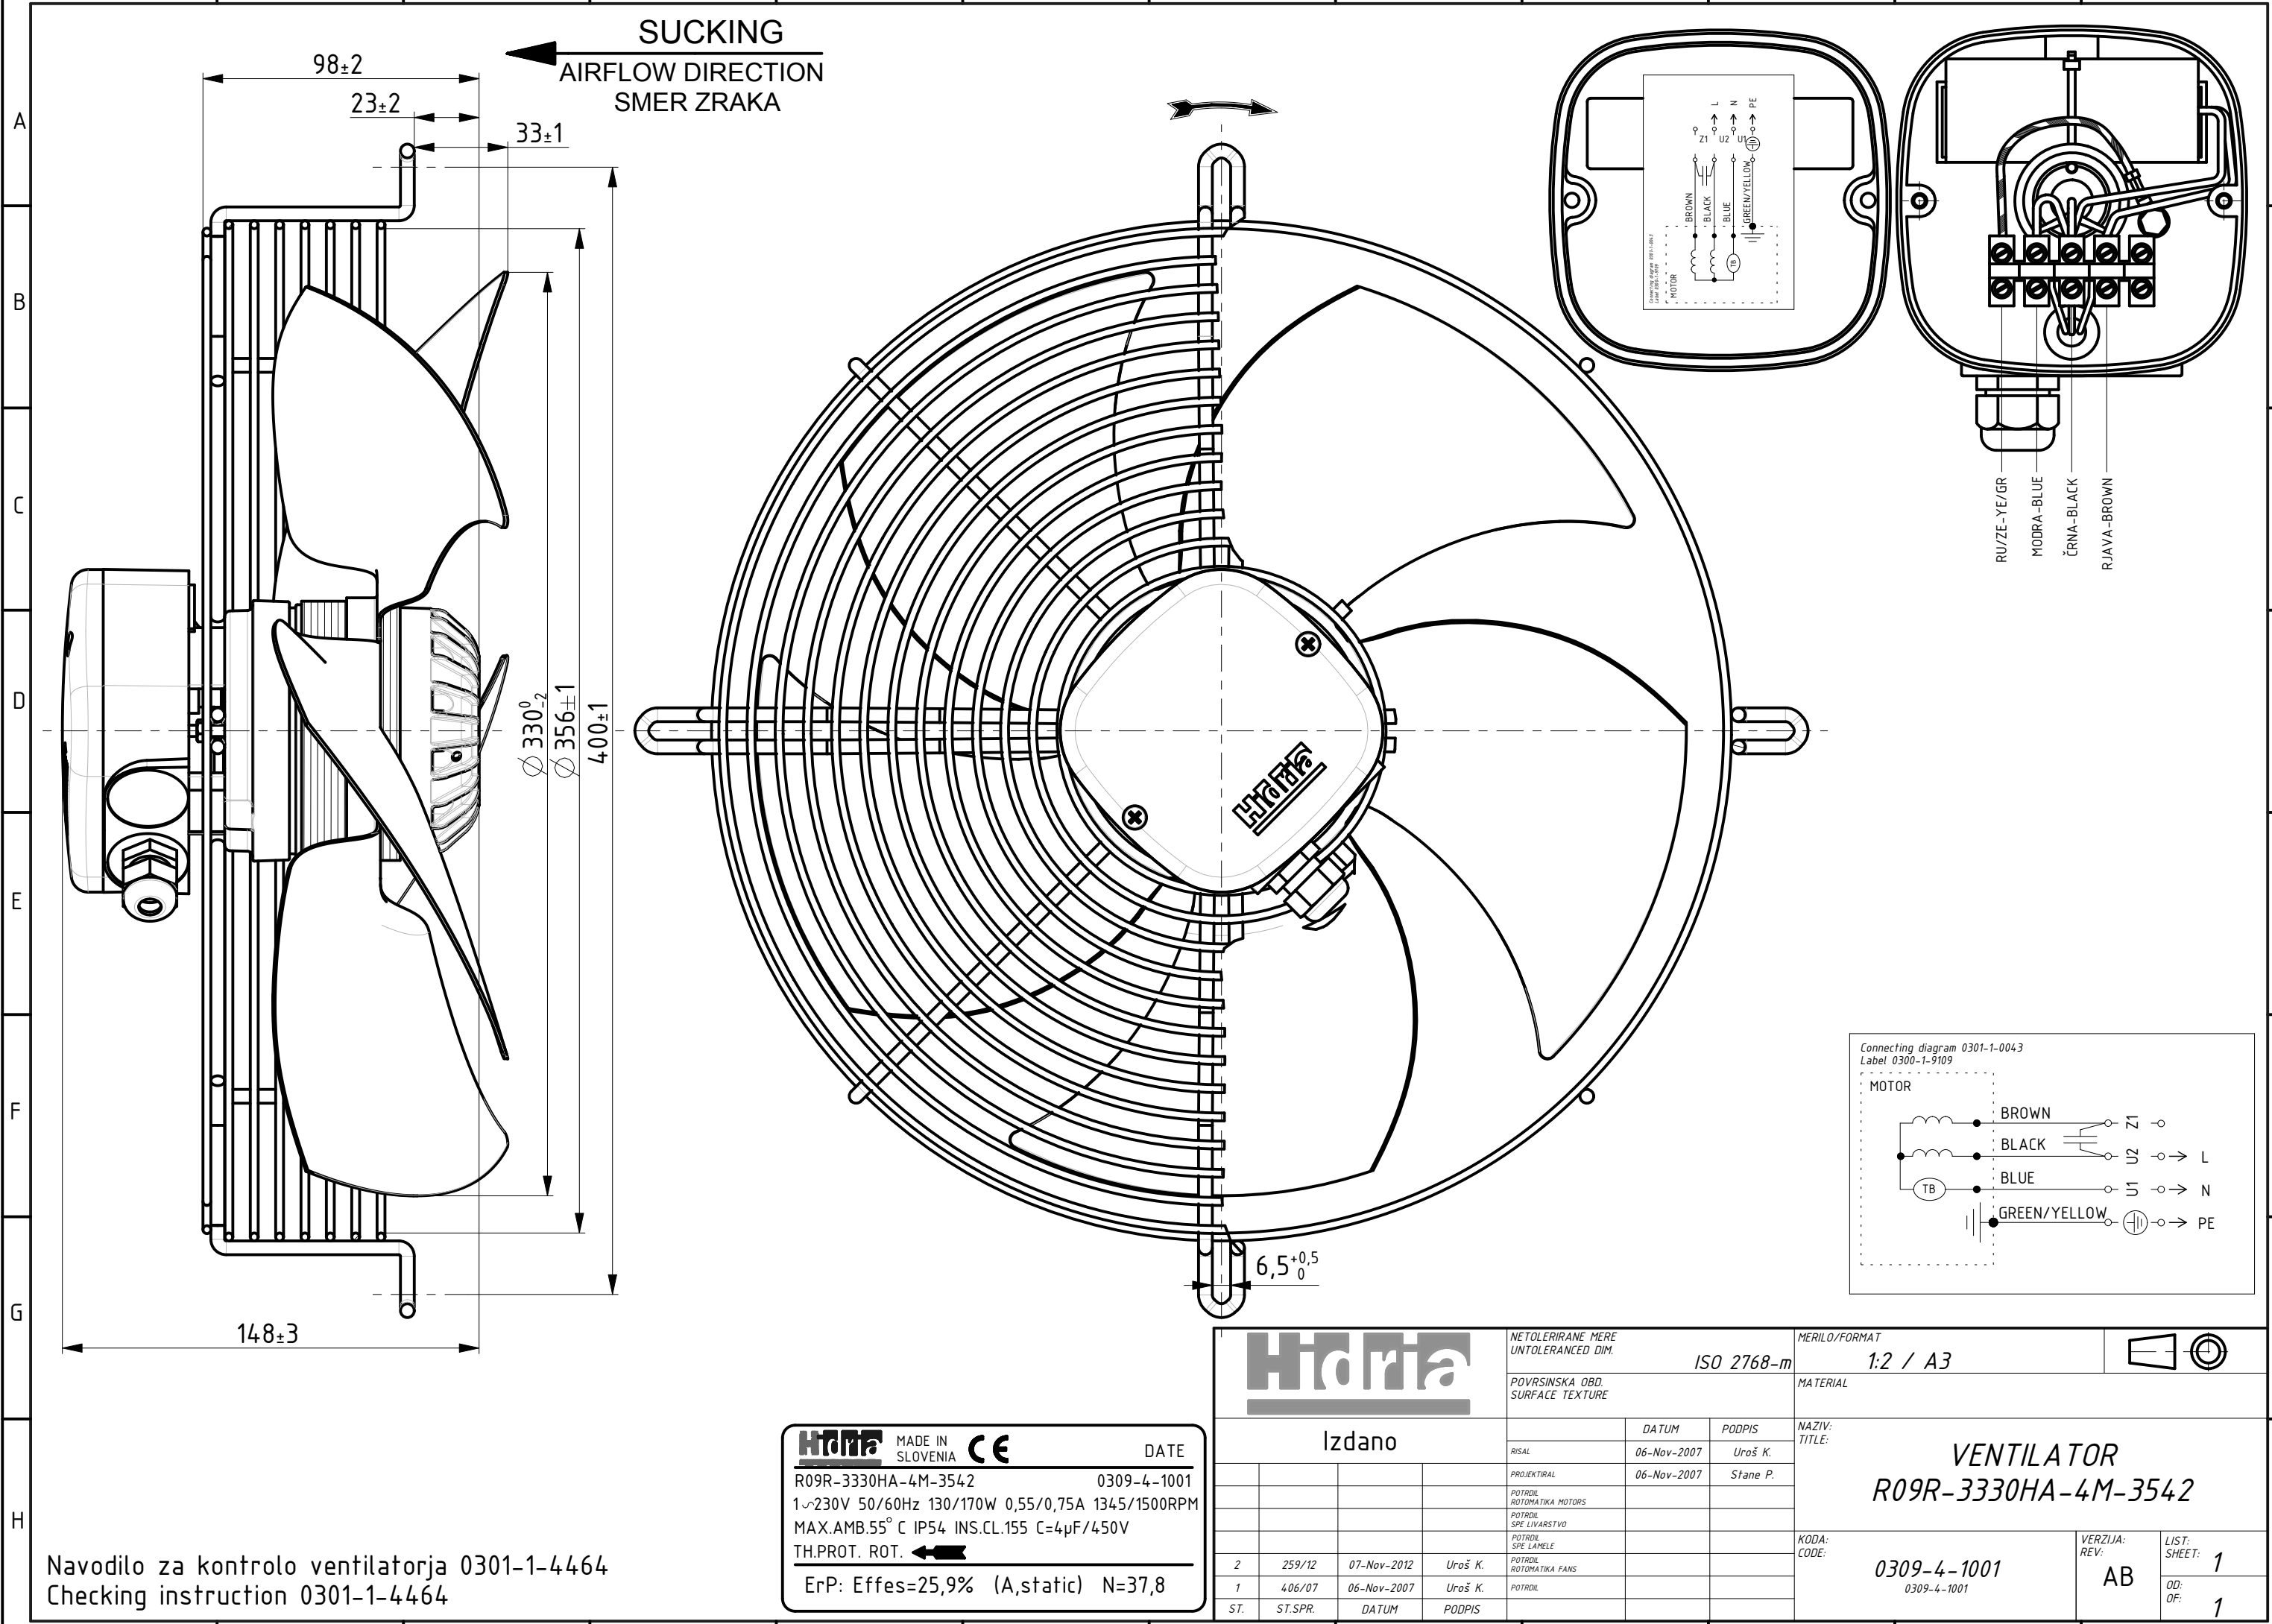


Navodilo za kontrolo ventilatorja 0301-1-4464
Checking instruction 0301-1-4464

**MADE IN SLOVENIA**

DATE
R09R-3330HA-4M-3542 0309-4-1001
1~230V 50/60Hz 130/170W 0,55/0,75A 1345/1500RPM
MAX.AMB.55° C IP54 INS.CL.155 C=4µF/450V
TH.PROT. ROT. 

ErP: Effes=25,9% (A,static) N=37,8

				NETOLERIRANE MERE UNTOLERANCED DIM.		ISO 2768-m		MERILO/FORMAT 1:2 / A3			
POVRŠINSKA OBD. SURFACE TEXTURE				MATERIAL		NAZIV: TITLE:		VENTILATOR R09R-3330HA-4M-3542		KODA: CODE:	
Izdano				DATUM		PODPIS		VERZIJA: REV:		LIST: SHEET: 1	
RISAL				06-Nov-2007		Uroš K.		AB		OD: OF: 1	
PROJEKTIRAL				06-Nov-2007		Stane P.					
POTRDLJ ROTOMATIKA MOTORS											
POTRDLJ SPE LIVARSTVO											
POTRDLJ SPE LAJELE											
POTRDLJ ROTOMATIKA FANS											
POTRDLJ											
2	259/12	07-Nov-2012	Uroš K.								
1	406/07	06-Nov-2007	Uroš K.								
ST.	ST.SPR.	DATUM	PODPIS								