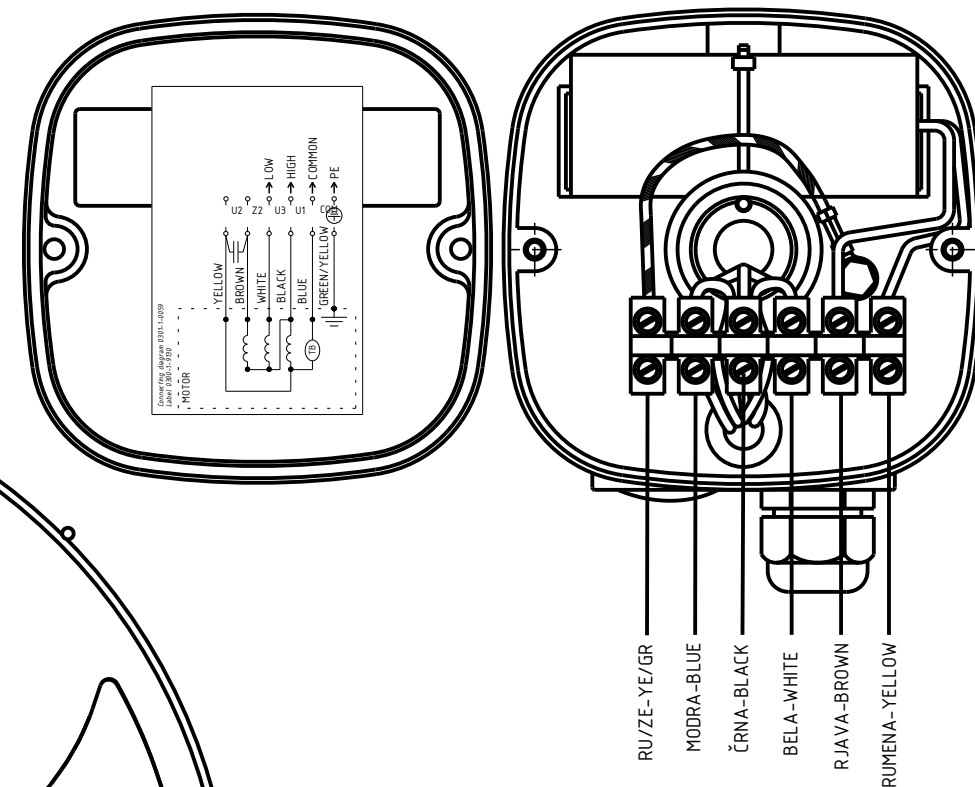



FAN FOR REPLACEMENT ONLY

For installation in application:


 MADE IN SLOVENIA
 
 DATE _____
 R09R-3530HP-4M2-4204 0309-4-1044
 1~230V 50Hz 140/90W 0,62/0,40A 1260/860RPM MAX.AMB.55°C
 1~230V 60Hz 170/100W 0,75/0,45A 1260/860RPM MAX.AMB.45°C
 IP54 INS.CL.155 C=4μF/450V
 TH.PROT. ROT. 

ErP: Effes=26,1% (A,static) N=37,9

AC	C	Na risbo se doda opombo ter simbol nalepke - nadomestni ventilator, nalepko se dodaja na embalažo ventilatorja. Spremeni se verzija z AB v AC. Risba v Windchillu je skladna z risbo v arhivu.		07.12.2015	Uroš T.
AB	B	Nalepko s podatki se uskladi z zahtevami ErP. Spremeni se verzija z AA v AB. Risba v Windchillu je skladna z risbo v arhivu.		05.04.13	Samuel B.
Verzija Artika: Article revision:	Verzija risbe: DRW Revision:	Opis spremembe: Description of change:		Datum: Date:	Izdelal: Produced:
	DATUM/DATE	IME / NAME	POVRŠINSKA OBD. SURFACE TEXTURE	NAZIV: TITLE: VENTILATOR R09R-3530HP-4M2-4204	
KONSTRUIRAL / DRN:	07.12.2015	Uroš Kunc			
ODOBRIL / APP:	10.12.2015	Uroš Tominec	MATERIAL		
Potrjeno/Approved			KODA MATERIALA MATERIAL CODE	MASA: MASS:	KODA: CODE: 0309-4-1044 0309-4-1044
			NETOL. MERE/UNTOL DIM.	DZJ	
			MERILO/FORMAT		
			ISO 2768-m		VERZIJA ARTIKLA: REVISION ARTICLE: AC
			2:5/A3		VERZIJA RISBE: DRW REVISION: C
					LIST/SHEET: 1/1