


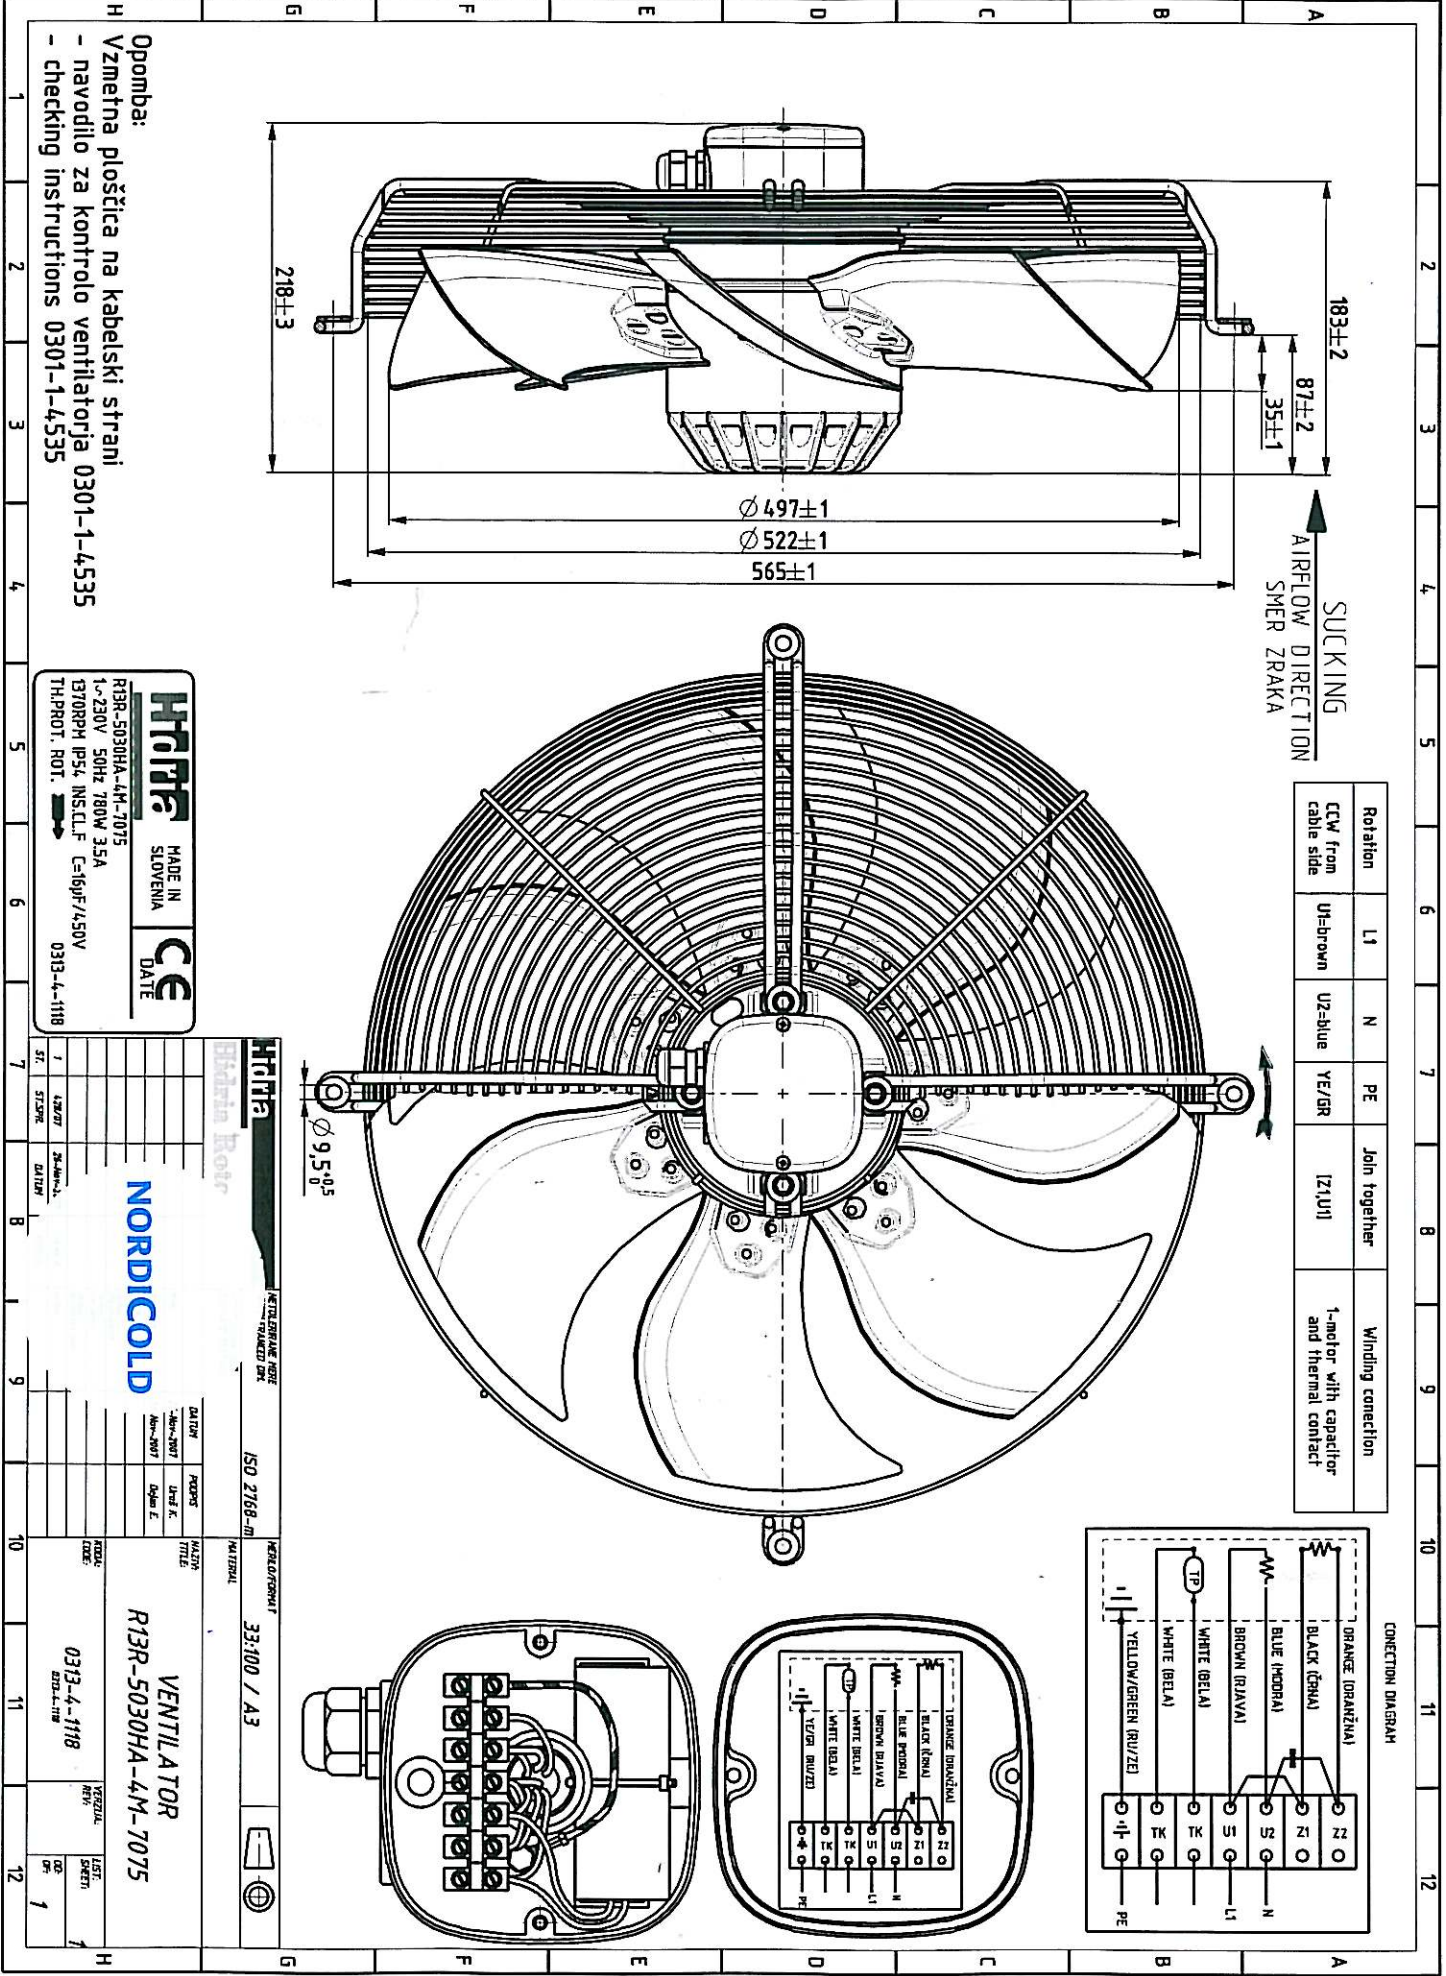

Opomba:
Vzmetna ploščica na kabelski strani
- navodilo za kontrolo ventilatorja 0301-1-4535
- checking instructions 0301-1-4535

HTT MADE IN SLOVENIA
DATE
R3R-5030HA-4M-7075
1~230V 50Hz 780W 3.5A
Ø70RPM IPS4, INS.CLF C=16pF/450V
TH:PROT. ROT. 0313-4-1118

HTT NORDICOLD
VENTILATOR
R3R-5030HA-4M-7075
0313-4-1118
ISO 2768-M
33/100 / A3
DATE: 10-2007
REV: 1
DRAWN: 1
CHECK: 1
DATE: 10-2007
REV: 1
DRAWN: 1
CHECK: 1