


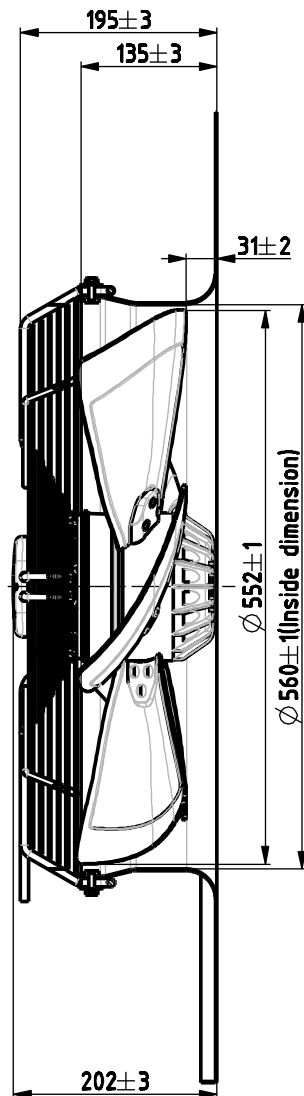


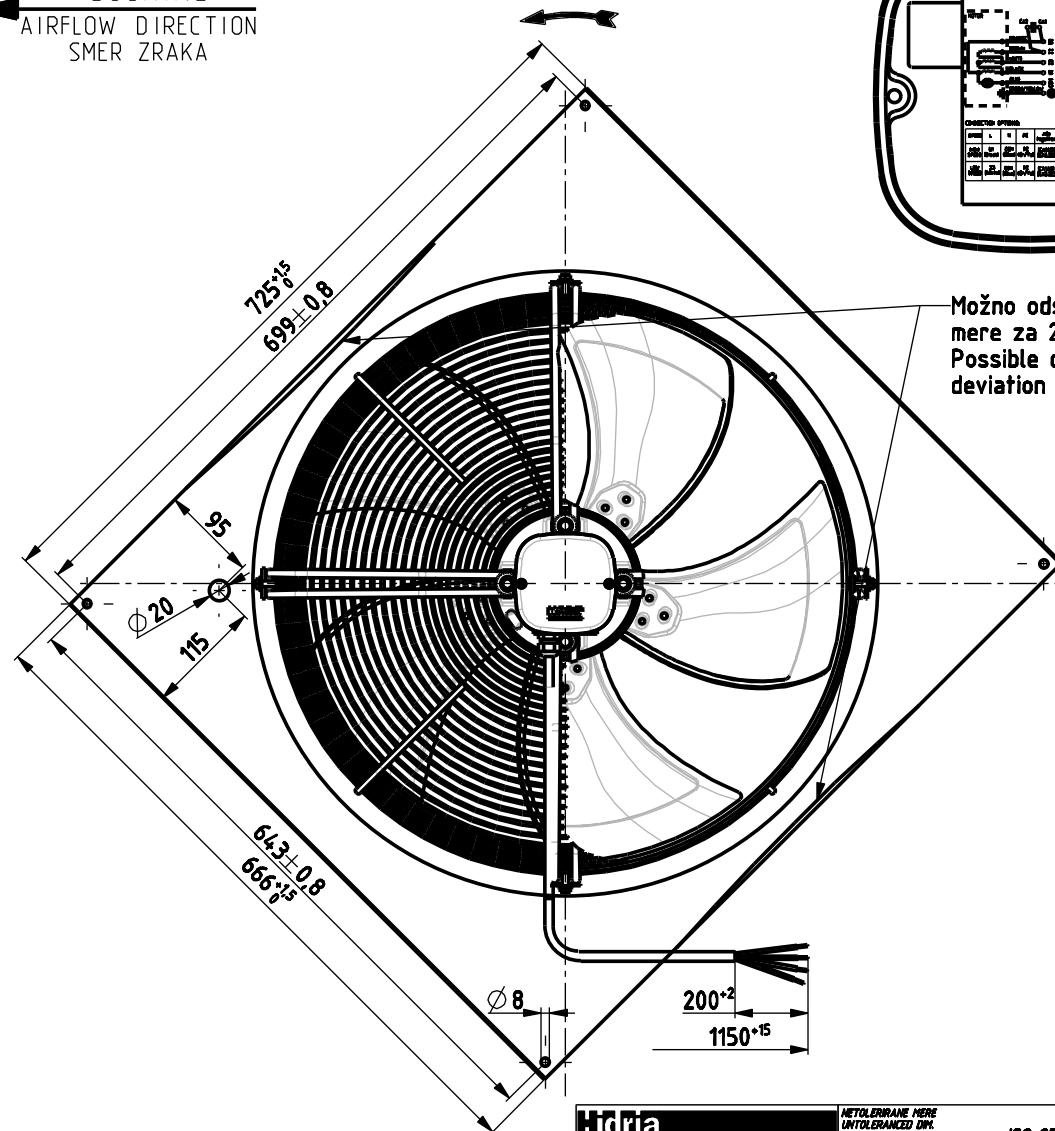

SUCKING
AIRFLOW DIRECTION
SMER ZRAKA

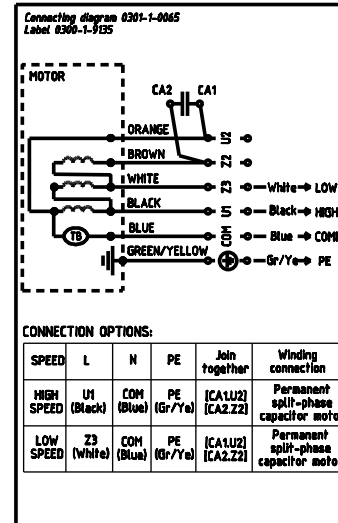

Možno odstopanje
mere za 2-3mm
Possible dimension
deviation for 2-3mm

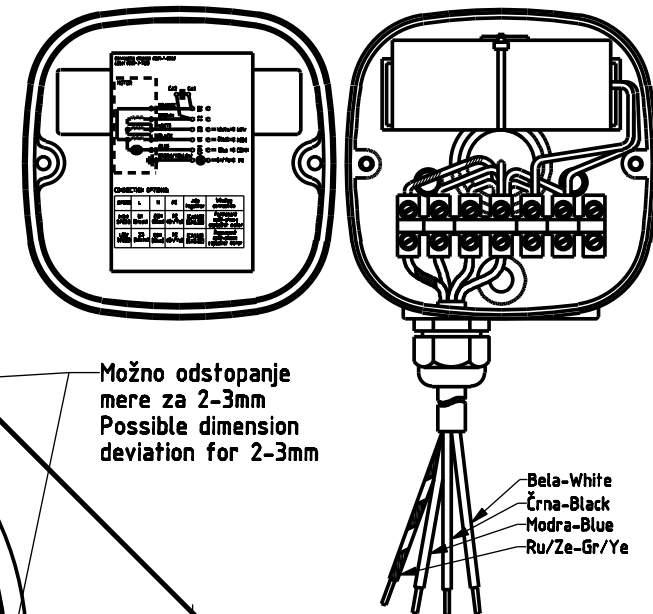

Opombe:
Vzmetna ploščica na kabelski strani
Navodilo za kontrolo ventilatorja 0301-1-4669
Checking instruction 0301-1-4669

HIMA FOR NORDICOLD CE
MADE IN SLOVENIA DATE
R13P-5630HA-8M2-5082
1~230V 50Hz 165/135W 0.75/0.60A
570/420RPM IP54 INS.CL.155 C=5µF/450V
TH.PROT. ROT. 0313-4-1133

Hidria			METOLERRANCE HERE (INTOLERANCED DIM.)			ISO 2768-M			HERRLO/FORMAT			1:5 / A3				
Hidria Rotomatika			POVRŠINSKA OBR. SURFACE TEXTURE						MATERIAL							
						REAL	DATUM	PODPIS	VENTILATOR Hef R13P-5630HA-8M2-5082							
						17-Aug-2009	Uroš K.									
					FINANCIAL	17-Aug-2009	Matjaž B.									
					GENERAL ADMINISTRATIVE PARTS											
						GENERAL SPE LAMINATE			KODA: CODE: 0313-4-1133 0313-4-1133							
3	688/09	03-Nov-2009		Uroš K.	GENERAL ADMINISTRATIVE PARTS											
2	348/09	29-Sep-2009		Uroš K.	GENERAL ADMINISTRATIVE PARTS											
1	293/09	17-Aug-2009		Uroš K.	GENERAL											
ST.	ST.SPR.			DATUM	PODPIS				VERZIJA: REV: 0313-4-1133							
									LIST: SHEET: 1							
									OP: 1							